



Managed Property Thermostat MP2211L

3-Stage Heat Pump
Manual Changeover
Hardwired

- Non-Programmable
- One-Time Configurable Temperature Set Points
- Patent-pending Abnormal Rate of Change (ARC) Detection Technology
- Placebo Option
- Three Stage Heat Pump Systems
- Backlit Display
- Field Calibration Feature
- Relay Outputs (minimum voltage drop in thermostat)




Installation, Operation & Application Guide

For more information on our complete range of American-made products – plus wiring diagrams, troubleshooting tips and more, visit us at www.icmcontrols.com



Parts Diagram

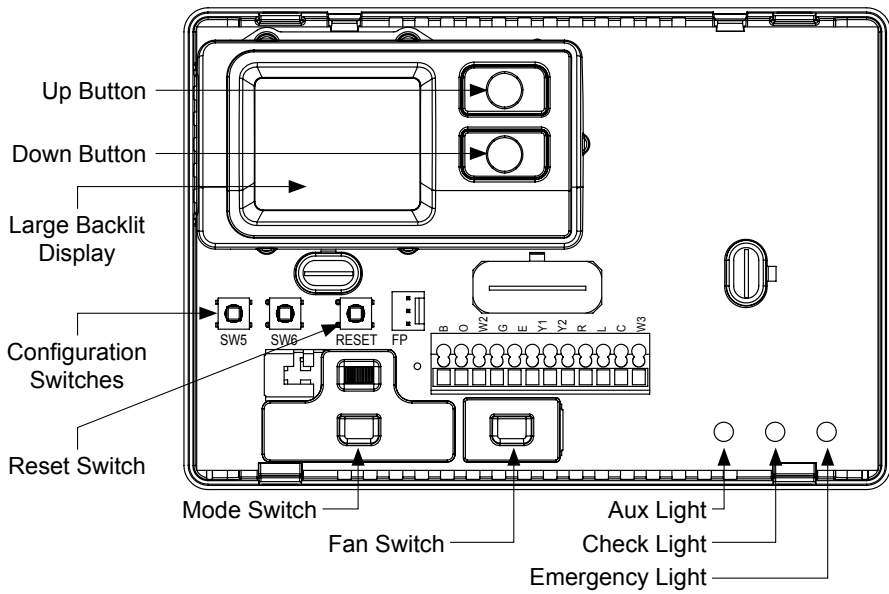

Specifications

- Electrical rating:** • 24 VAC (18-30 VAC)
• 4 amp maximum total load
• 1 amp maximum per terminal
- Temperature control range:** 45°F to 90°F (7°C to 32°C) **Accuracy:** ± 1°F (± 0.5°C)
- System configurations:** 3-stage heat, 2-stage cool heat pump
- Timing:** Anti-short Cycle: 4 minutes
Backlight Operation: 10 seconds
- Terminations:** C, L, R, B, O, W2, G, E, Y1, Y2, W3

Important Safety Information

WARNING! Always turn off power at the main power supply before installing, cleaning, or removing thermostat.

- This thermostat is for 24 VAC applications only; do not use on voltages over 30 VAC
- All wiring must conform to local and national electrical and building codes
- Do not use air conditioning when the outdoor temperature is below 50 degrees; this can damage your A/C system and cause personal injuries
- Use this thermostat only as described in this manual

Package Contents/Tools Required

Package includes: MP2211L thermostat on base, thermostat cover, wiring labels, screws and wall anchors, Installation, Operation and Application Guide

Tools required for installation: Drill with 3/16" bit, hammer, screwdriver

To Remove Existing Thermostat

ELECTRICAL SHOCK HAZARD – Turn off power at the main service panel by removing the fuse or switching the appropriate circuit breaker to the OFF position before removing the existing thermostat.

1. Turn off power to the heating and cooling system by removing the fuse or switching the appropriate circuit breaker off.
2. Remove cover of old thermostat. This should expose the wires.
3. Label the existing wires with the enclosed wire labels before removing wires.
4. After labeling wires, remove wires from wire terminals.
5. Remove existing thermostat base from wall.
6. Refer to the following section for instructions on how to install this thermostat.

To Install Thermostat



ELECTRICAL SHOCK HAZARD – Turn off power at the main service panel by removing the fuse or switching the appropriate circuit breaker to the OFF position before removing the existing thermostat.

IMPORTANT: Thermostat installation must conform to local and national building and electrical codes and ordinances.

***Note:** Mount the thermostat about four feet above the floor. Do not mount the thermostat on an outside wall, in direct sunlight, behind a door, or in an area affected by a vent or duct.

1. Turn off power to the heating and cooling system by removing the fuse or switching the appropriate circuit breaker off.
 2. To remove cover, insert and twist a coin or screwdriver in the slots on top of the thermostat.
 3. Put thermostat base against the wall where you plan to mount it (Be sure wires will feed through the wire opening in the base of the thermostat).
 4. Mark the placement of the mounting holes.
 5. Set thermostat base and cover away from working area.
 6. Using a 3/16" drill bit, drill holes in the places you have marked for mounting.
 7. Use a hammer to tap supplied anchors in mounting holes.
 8. Align thermostat base with mounting holes and feed the control wires through wire opening.
 9. Use supplied screws to mount thermostat base to wall.
 10. Insert stripped, labeled wires in matching wire terminals. See "Wiring Diagrams" section of this manual.
- CAUTION!** Be sure exposed portion of wires does not touch other wires.
11. Gently tug wire to be sure of proper connection. Double check that each wire is connected to the proper terminal.
 12. Seal hole for wires behind thermostat with non-flammable insulation or putty.
 13. Replace cover on thermostat by snapping it in place.
 14. Turn on power to the system at the main service panel.
 15. Test thermostat operation as described in "Testing the Thermostat".



Terminal Designator Descriptions

- | | |
|---------------------------------|--|
| B – heat active reversing valve | Y1 – 1st stage cool, 1st stage heat |
| O – cool active reversing valve | Y2 – 2nd stage cool for 2 compressor systems |
| W2 – 2nd stage heat | R – 24 VAC hot |
| G – Fan | L – Check indicator |
| E – 1st stage emergency heat | C – 24 VAC common |
| | W3 – 3rd stage heat |

MP2211L Output Chart

	1 ST Cool	2 ND Cool	1 ST Heat	2 ND Heat	3 RD Heat
Heat Pump	Y1, G, O	Y1, Y2, G, O	Y1, G, B	Y1, W2, G, B	Y1, W2, W3, G, B
Emergency Heat	N/A	N/A	E, G	E, W2, G	E, W2, W3, G

Wiring Diagram Conversions

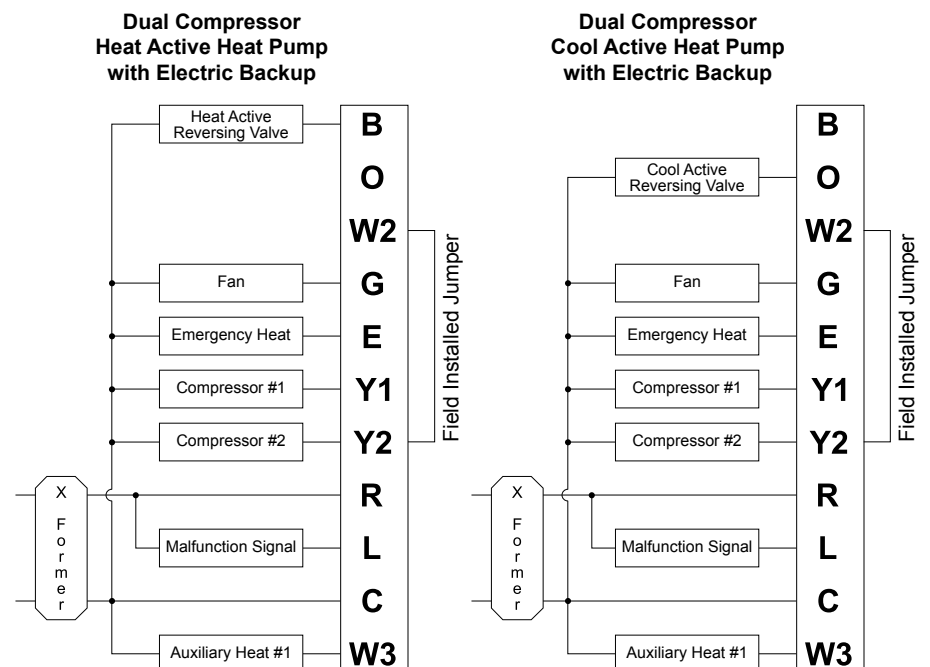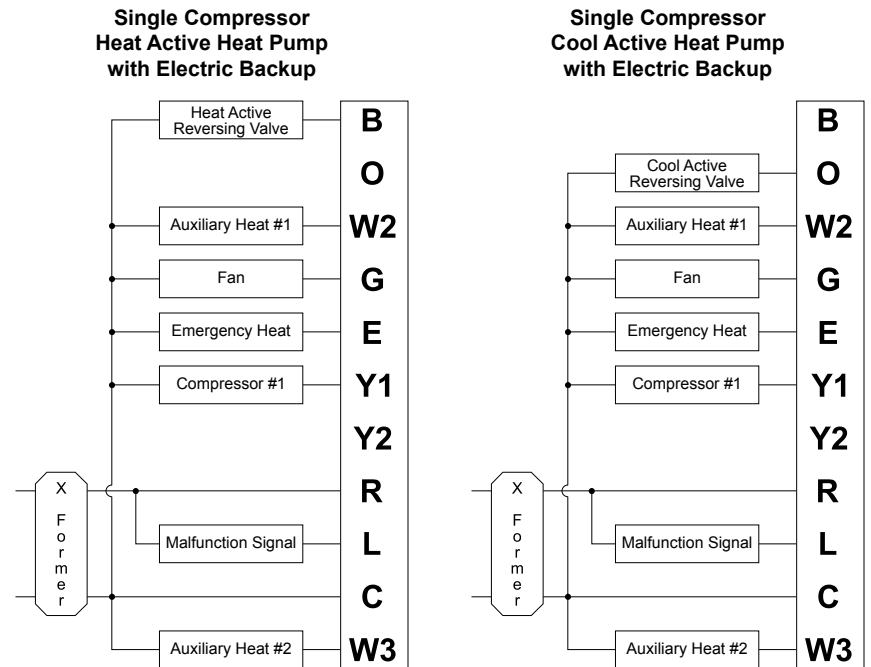

Configuration Mode

The configuration mode is used to set the **MP2211L** to match your heating/cooling system. The **MP2211L** functions with up to 3-stage heat pump systems.

To configure the **MP2211L**, perform the following steps:

- Slide the **Mode** switch to the **OFF** position.
- Remove the cover of the thermostat by gently pulling on one of the corners.
- Simultaneously hold the **SW5** & **SW6** buttons in for 2 seconds while the **MP2211L** is in **OFF** mode.
- Press the **down** or **up** button to change settings within each screen.
- Press the **SW6** button to advance to the next screen.
 - * **Note:** The **SW5** button will return you to the previous screen.
- To exit configuration mode, slide the **Mode** switch to **Heat** or **Cool**.

Configuration Mode Settings

The setup screens for Configuration Mode are as follows:

- Temperature Scale (F or C)** – Choose Fahrenheit or Celsius.

Press the **down** or **up** button to select.
Press the **SW6** button to advance to the next screen.




- Temperature Differential – Stage 1 – (1°F to 5°F) (0.5°C to 2.5°C)**

Set the number of degrees between your “setpoint” temperature and your “turn on” temperature for first stage.
Press the **down** or **up** button to set differential value.
Press the **SW6** button to advance to the next screen.




- Temperature Differential – Stage 2 – (1°F to 5°F) (0.5°C to 2.5°C)**

Set the number of degrees between when stage 1 turns on and stage 2 turns on.
Press the **down** or **up** button to set differential value.
Press the **SW6** button to advance to the next screen.



- Temperature Differential – Stage 3 – (1°F to 5°F) (0.5°C to 2.5°C)**


Set the number of degrees between when stage 2 turns on and stage 3 turns on.
Press the **down** or **up** button to set differential value.
Press the **SW6** button to advance to the next screen.



- Staged Off Outputs**

Select whether the outputs for heating and cooling are staged off independently or are satisfied simultaneously.

- 0 = Comfort Mode – Outputs are staged on and all stages cycle off simultaneously when set point is satisfied.
- 1 = Economy Mode – Outputs are staged on and off in accordance with set point and differential.



- Maximum Heat Setpoint (45°F to 75°F) (7°C to 24°C)**

Adjust to control the maximum Heat set temperature allowed.
Press the **down** or **up** button to select.
Press the **SW6** button to advance to the next screen.



- Minimum Cool Setpoint (70°F to 90°F) (21°C to 32°C)**

Adjust to control the minimum Cool set temperature allowed.
Press the **down** or **up** button to select.
Press the **SW6** button to advance to the next screen.




- Room temperature offset (+9°F to -9°F) (+4.5°C to -4.5°C)**

Adjust to calibrate displayed room temperature to match actual room temperature (**must be adjusted before permanent lock**).

* **Note:** When not set to 0, **ROOM** will display.

Press the **down** or **up** button to select.
Press the **SW6** button to advance to the next screen.



- Placebo Feature** – Set point can be set to wide range but they will be controlled to maximum heat set point and minimum cool set point.

0 = Feature OFF 1 = Feature ON

Press the **up** or **down** button to select.
Press the **RIGHT** switch to advance to the next screen.



- Permanent Lock Screen**

Hold up and down button until counter reaches 0 to permanently lock configuration screens.

!!! VERY IMPORTANT !!!

Configuration screens #6 to #10 can't be changed after they are permanently locked. To reconfigure, a locked thermostat must be returned to ICM Controls for reprogramming, which involves a fee.

Press the **SW5** button to review settings.

Press the **Mode** switch to **Heat** or **Cool** to exit configuration.



Starting the Thermostat

CAUTION!: Do not use air conditioning when the outdoor temperature is below 50 degrees. This can damage your air conditioning system and cause personal injuries.

- Move the **Fan Auto/On** switch to the **Auto** position.
- Move the **Cool/Off/Heat/Emer** switch to **Cool** or **Heat**, depending on the season.



LED Indicators

There are three LED indicators located on the front of the thermostat. They are designed to inform you about the following:

LED	Color	Function
AUX	Green	<ul style="list-style-type: none"> This turns on when the auxiliary (second stage) heating is in operation Turns on 1-6°F below first stage and is user adjustable (see Configuration Mode, Step 3)
CHECK	Red	<ul style="list-style-type: none"> When this turns on, a malfunction has occurred somewhere in the heat pump system Please contact a qualified service technician as soon as possible to check your system
EMER	Red	<ul style="list-style-type: none"> This light turns on whenever the emergency heat is manually selected (Mode switch is in the EMER position) While in the emergency Heat mode, the heat pump compressor is off, and the emergency heat (same as the auxiliary heat) maintains the setpoint temperature

Testing the Thermostat

Once the thermostat is installed, it should be thoroughly tested.

CAUTION!: Do not energize the air conditioning system when the outdoor temperature is below 50 degrees. It can result in equipment damage or personal injury.

Cool Test


- Slide **Mode** switch to **Cool** mode.
- Adjust set temperature so it is 5 degrees below room temperature.
- Air conditioning should come on within a few seconds.
- Adjust the set temperature 2 degrees above the room temperature and the A/C should turn off. There may be a fan delay on your system.

* **Note:** There is a 4-minute time delay to protect the compressor after it turns off. To temporarily bypass the 4-minute delay, slide the **Mode** switch to **OFF** for 2 sec. and then back to **Cool**.




Heat Test

- Slide **Mode** switch to **Heat** mode.
- Adjust the set temperature so it is 5 degrees above the room temperature.
- Heat should come on within a few seconds.
- Adjust the set temperature so it is 2 degrees below the room temperature and the heat should turn off. There may be a fan delay on your system.
 - * **Note:** There is a four minute time delay to protect the compressor after it turns off. To temporarily bypass the four minute delay, slide the **Mode** switch to **OFF** for 2 seconds and then back to **Heat**.



Emergency Heat Test

- Slide **Mode** switch to **Emer** position (Emer LED lights).
- Adjust the set temperature so it is 5 degrees above the room temperature. There may be a four minute delay.
- Second stage heat should come on (Aux LED lights).
- Adjust the set temperature so it is 2 degrees below the room temperature. Heat should turn off. There may be a fan delay on your system.



Fan Test

- Slide **Fan** switch to **On** position.
- Indoor fan turns on.
- Slide **Fan** switch to **Auto** position.
- Indoor fan turns off.



Mode of Operation

The **MP2211L** is a multi-stage, heat pump thermostat for 24 VAC systems.

The thermostat activates the heat pump when the room temperature is below the heat set temperature (by the differential temperature). Auxiliary heat will be activated if the room temperature continues to drop. Third stage heat is activated (on some systems) if the temperature drops further. The heat outputs are staged off (configurable, setting 5) as the room temperature increases. The thermostat will not let the compressor come on for four minutes after it turns off. This protects your compressor.

When the room temperature is greater than the cool set temperature (by the differential temperature), the cooling device is activated. Second-stage cooling will be activated if the room temperature continues to rise. The cool outputs are staged off (configurable, setting 5) as the room temperature decreases. The thermostat will not let the compressor come on for four minutes after it turns off. This protects your compressor.

The **MP2211L** has the following operating modes: **OFF**, **Heat**, **Emergency Heat** and **Cool**. In **OFF** mode, the thermostat will not turn on heating or cooling devices. In the **Heat** mode, the thermostat controls the heat pump system. In the **Emergency Heat** mode, the heat pump is bypassed and auxiliary becomes the primary heat source. In the **Cool** mode, the thermostat controls the cooling system. The indoor fan can be turned on in all operating modes using the **Fan** switch.

ARC Detection Technology

This thermostat comes enabled with ICM Controls' patent-pending Abnormal Rate of Change (ARC) detection technology that helps deter tenants from attempting to “trick” the thermostat into a false reading. Upon sensing an abnormal rise or drop in temperature, the thermostat operation will automatically default into a lockout sequence. The display will show **Err** for an abnormal RISE in temperature, or **Erd** for an abnormal DROP in temperature. When the thermostat returns to normal operation, the error message can be cleared with the press of any button.

Troubleshooting

Symptom	Remedy
No display	Check for 24 VAC at thermostat; display is blank when 24 VAC is not present
System fan does not come on properly	Verify wiring is correct
Thermostat turns on and off too frequently	Adjust temperature differential (see “Temperature Differential,” Stage 1, Step 2)
Fan runs continuously	Check fan On/Auto switch, ON position runs indoor fan continuously
Auxiliary heat not on soon enough	Adjust differential for 2nd and 3rd stage heating if required (see Configuration, Steps 3 and 4)
Err or Erd on display	Abnormal Rate of Change (ARC) detected. Thermostat defaults into lockout sequence. When normal operation resumes, error message can be cleared with press of any button
Problem not listed above	Press the Reset button once; display will be refreshed and anti-short cycle timing will be reset to zero

ONE-YEAR LIMITED WARRANTY

The Seller warrants its products against defects in material or workmanship for a period of one (1) year from the date of manufacture. The liability of the Seller is limited, at its option, to repair, replace or issue a non-case credit for the purchase prices of the goods which are provided to be defective. The warranty and remedies set forth herein do not apply to any goods or parts thereof which have been subjected to misuse including any use or application in violation of the Seller's instructions, neglect, tampering, improper storage, incorrect installation or servicing not performed by the Seller. In order to permit the Seller to properly administer the warranty, the Buyer shall: 1) Notify the Seller promptly of any claim, submitting date code information or any other pertinent data as requested by the Seller. 2) Permit the Seller to inspect and test the product claimed to be defective. Items claimed to be defective and are determined by Seller to be non-defective are subject to a \$30.00 per hour inspection fee. This warranty constitutes the Seller's sole liability hereunder and is in lieu of any other warranty expressed, implied or statutory. Unless otherwise stated in writing, Seller makes no warranty that the goods depicted or described herein are fit for any particular purpose.



Patent No. 424,953 – Design

Patent No. 6,597,275 – Thermal Intrusion Barrier

7313 William Barry Blvd., North Syracuse, NY 13212
(Toll Free) 800-365-5525 (Phone) 315-233-5266 (Fax) 315-233-5276

www.icmcontrols.com